

### APPLICATION

LFDW model is designed to be used in clean space environments such as medical facilities (pharmaceutical / biotechnology industry), research industries (semiconductors, aerospace industries), hospital operating and clean rooms.

LFDW have low aspiration characteristics resulting in rapid temperature and velocity equalization of air mass into the zone of occupancy.

### FEATURED STANDARD CONSTRUCTION

- **OUTER FRAME**

- Constructed from 16 Ga galvanized steel sheets with continuously welded corners to eliminate leakage.

- **FACE**

- Constructed from 4 mm hole diameter perforated galvanized steel sheets.

- **FILTER FIXATION**

- Standard Steel Clamp.

- **SIZES**

- Available sizes are: { 24" x 24" } { 36" x 24" } { 48" x 24" } OR { 600mm x 600mm } { 900mm x 600mm } { 1200mm x 600mm }

- **FINISH**

- RAL 9010 White Finish.



### OPTIONS

- 16 Ga Galvanized Steel construction.
- 1.5 mm Stainless Steel 304 construction.
- 1.5 mm Stainless Steel 316 construction.
- 1.5 mm Aluminum construction.
- Aluminum, Stainless Steel 304 and Stainless Steel 316 perforated sheets for the face.
- 3 cm extruded Aluminum flange for Aluminum and Galvanized construction for T-bar mount.
- 3 cm Stainless Steel duct flange for Stainless Steel construction for T-bar mount.
- HEPA filter H13 (99.95% degree of arrestance) or H14 (99.995% degree of arrestance) grade.
- Stainless Steel handle for filter fixation.

**N.B: A 0.5 cm clearance is deducted from your order size.**


*For more information please consult our engineers.*

Tests Conducted in accordance with ASHRAE Standard 70-2006 in ETL-ETS USA

Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.

### ILLUSTRATIONS

#### Fully-Welded

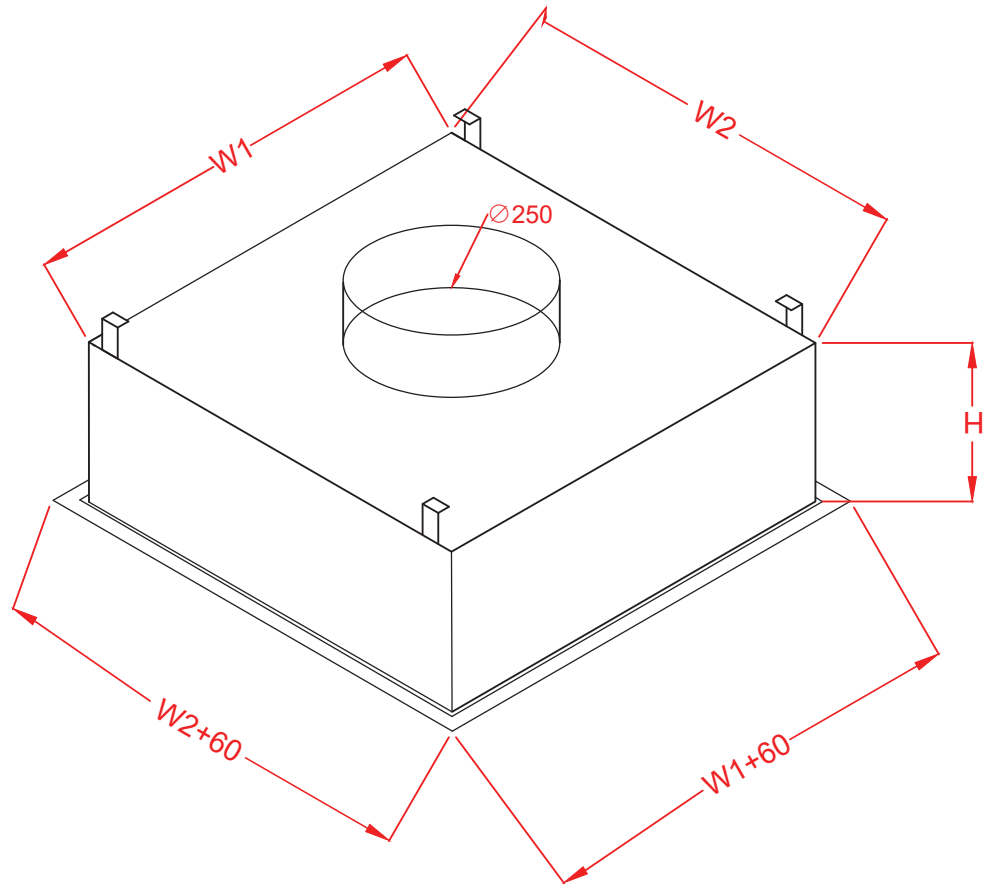

All Older Sizes	Number of Inlet	Round Neck (mm)	H (mm) LFDW200	H (mm) LFDW100
	1	250	200	150

**N.B: A 0.5 cm clearance is deducted from your order size.**

*For more information please consult our engineers.*

Tests Conducted in accordance with ASHRAE Standard 70-2006 in ETL-ETS USA

Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.

### ILLUSTRATIONS


Fully-Welded

Order Size


24"x24" or 600mm x 600mm

**LFDW200 : Construction of LFD with filter support**

Note: Fit for KBE proposed hepa filters only

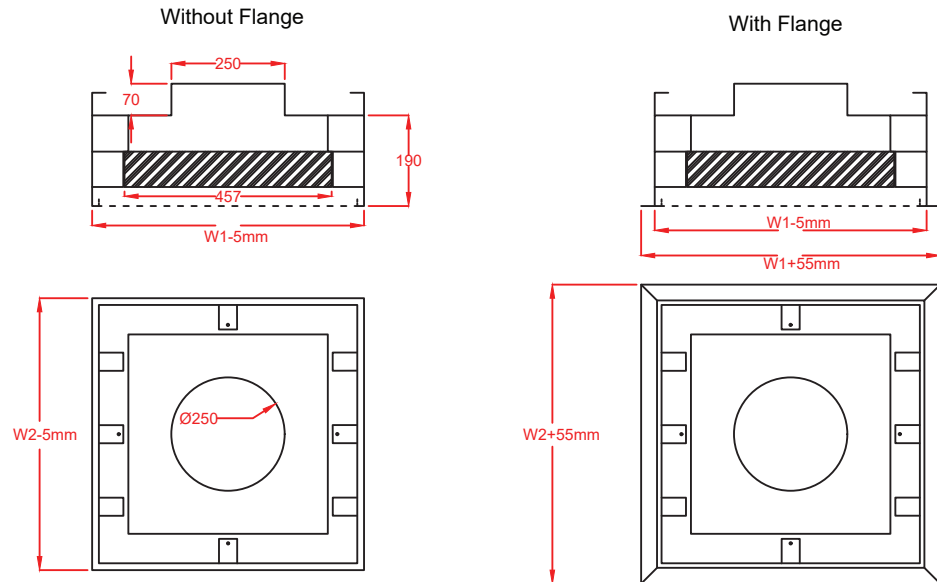

**LFDW100 : Construction of Diffuser without filter support**

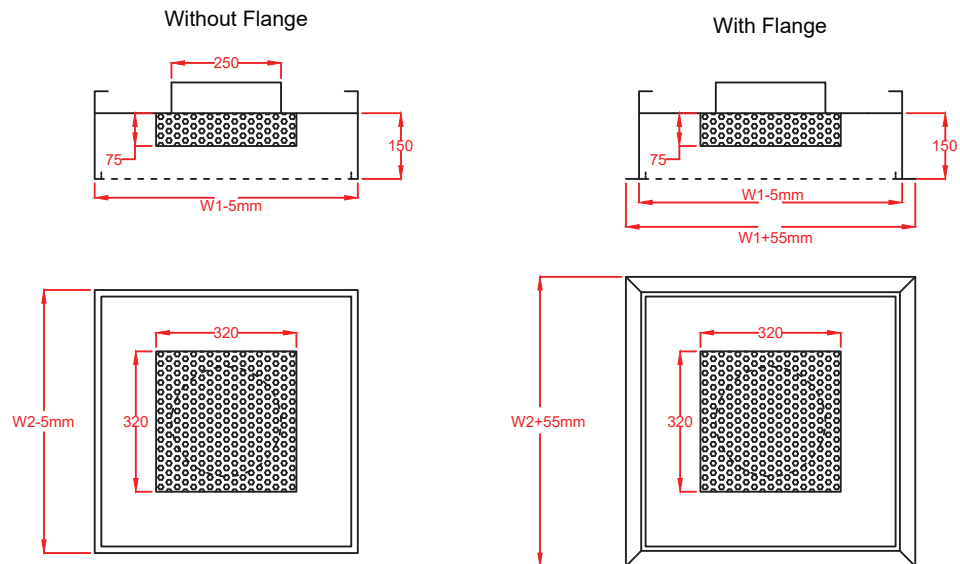

**N.B: A 0.5 cm clearance is deducted from your order size.**

*For more information please consult our engineers.*


Tests Conducted in accordance with ASHRAE Standard 70-2006 in ETL-ETS USA

Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.


### ILLUSTRATIONS

Fully-Welded

**Order Size:**  
**36"x24" or 900mm x 600mm**  
**LFDW200: Construction of LFD with filter support**  
 Note: Fit for KBE proposed hepa filters only

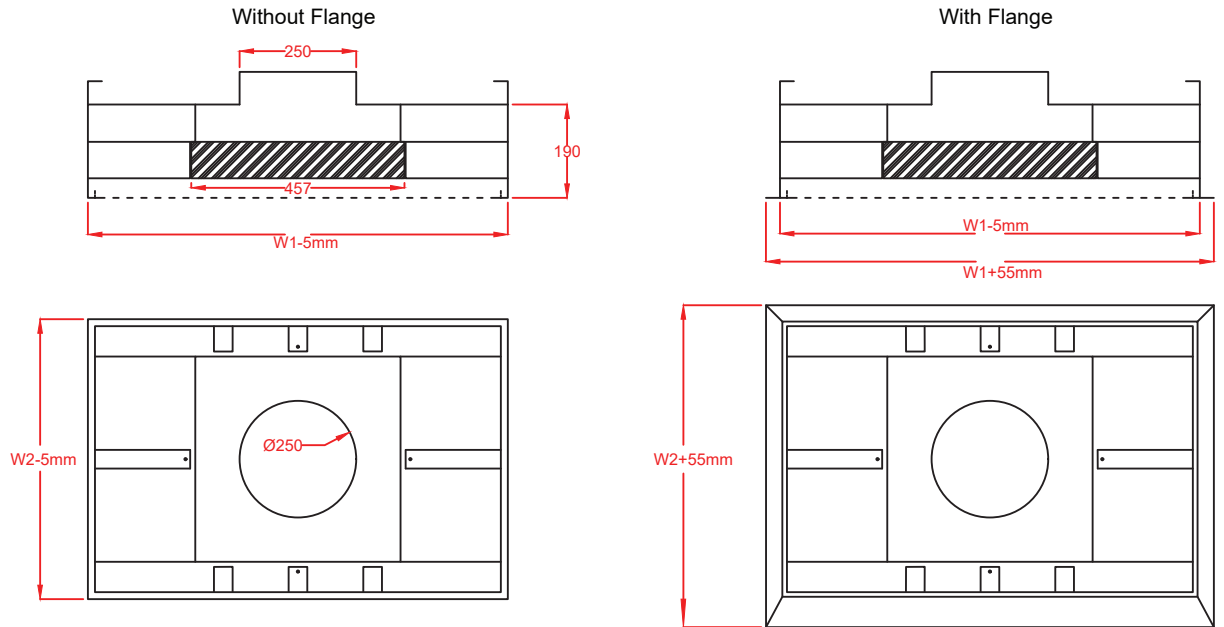

### LFDW100: Construction of Diffuser without filter support

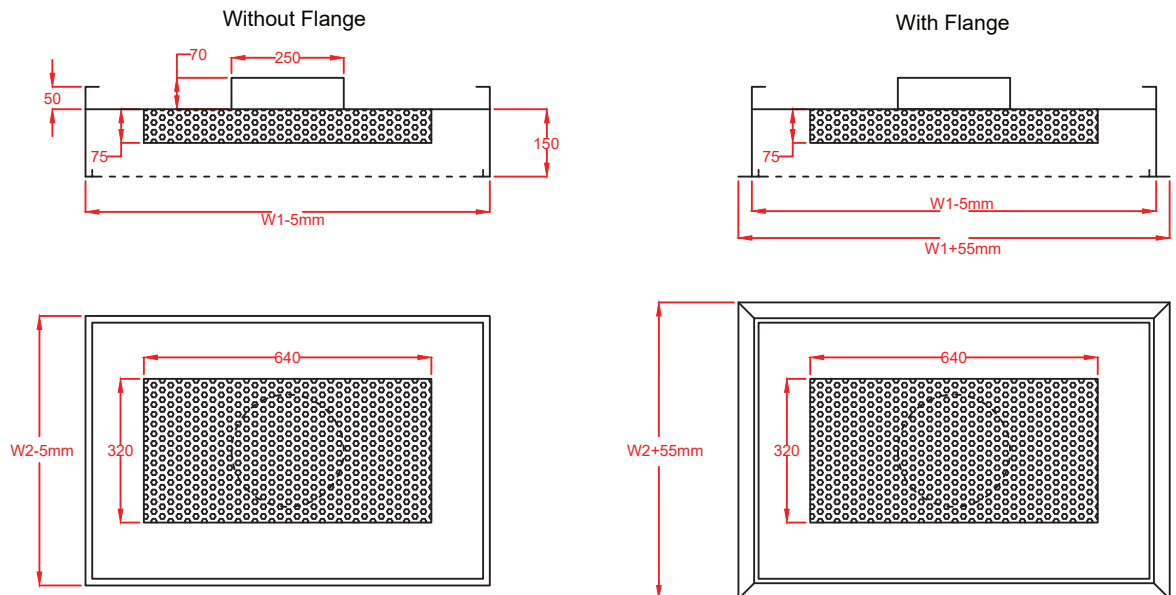

**N.B: A 0.5 cm clearance is deducted from your order size.**

*For more information please consult our engineers.*

Tests Conducted in accordance with ASHRAE Standard 70-2006 in ETL-ETS USA

Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.

### ILLUSTRATIONS


Fully-Welded

Order Size


48"x24" or 1200mm x 600mm

**LFDW200 : Construction of LFD with filter support**

Note: Fit for KBE proposed hepa filters only

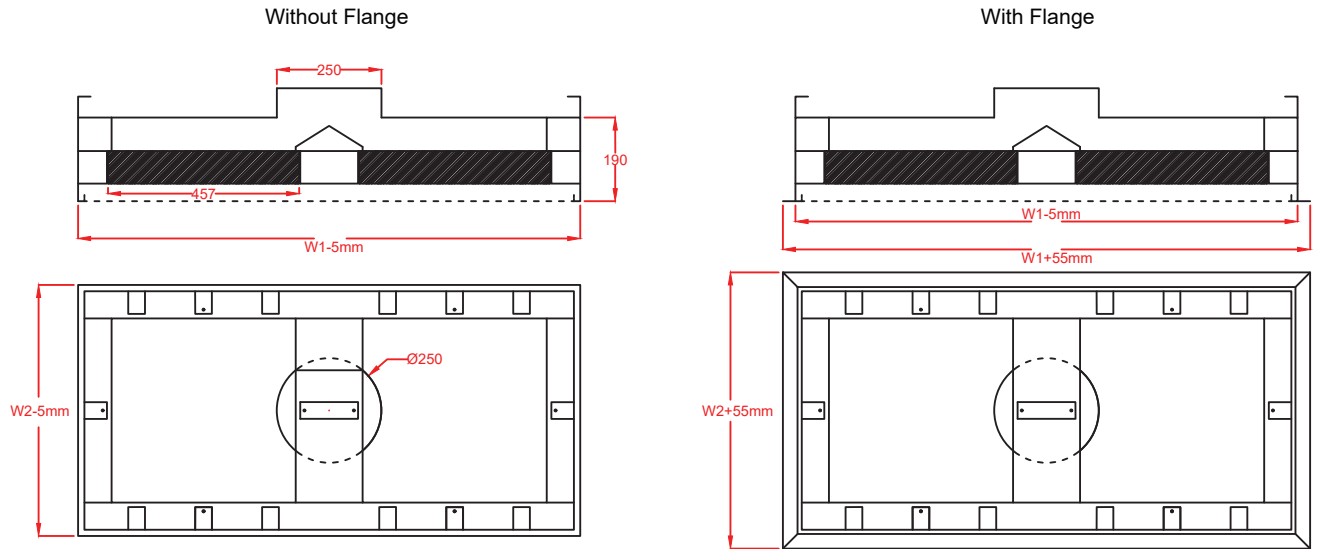

**LFDW100 : Construction of Diffuser without filter support**

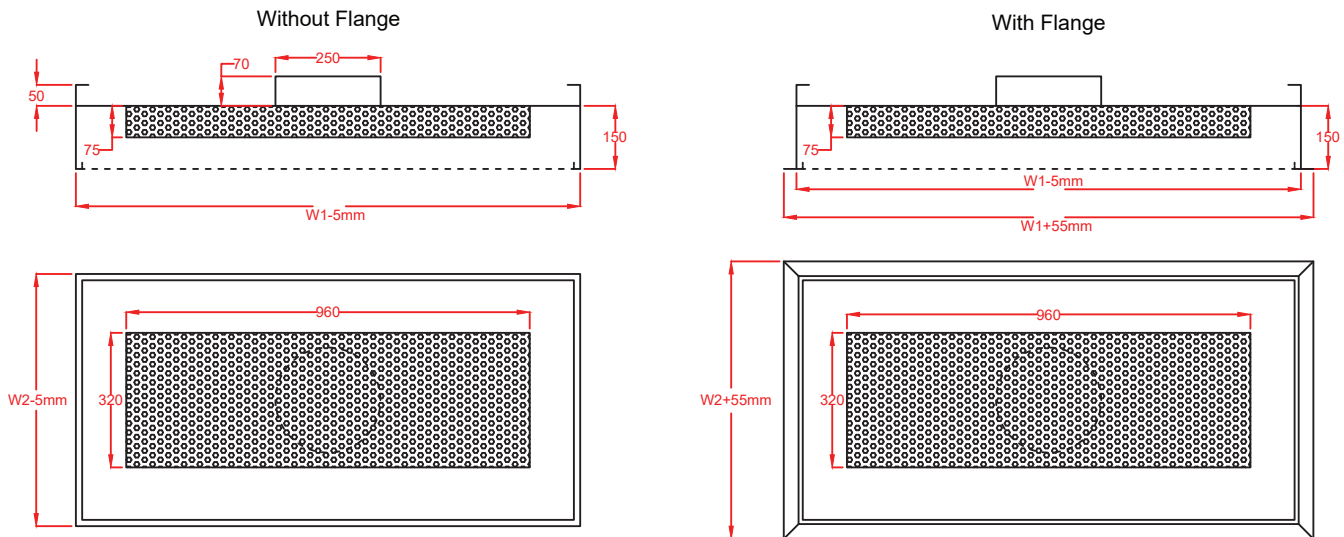

**N.B: A 0.5 cm clearance is deducted from your order size.**

*For more information please consult our engineers.*

Tests Conducted in accordance with ASHRAE Standard 70-2006 in ETL-ETS USA

Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.



# LAMINAR FLOW DIFFUSER

## LFD/LFDW Series

### PERFORMANCE DATA

Unit Size (In.)	Ak Factor (Ft <sup>2</sup> )	Velocity (Cfm/ft <sup>2</sup> )	20	30	40	50	60	70	80
<b>24x 24</b> Neck Size Diam 10''	<b>2.03</b>	<b>Airflow</b>	<b>80</b>	<b>120</b>	<b>160</b>	<b>200</b>	<b>240</b>	<b>280</b>	<b>320</b>
		<b>SP.</b>	0.001	0.003	0.005	0.008	0.012	0.016	0.021
		<b>NC</b>	<15	<15	<15	<15	<15	<15	<15
		<b>A.V (Fpm)</b>	30	44	58	71	82	92	101
<b>36 x 24</b> Neck Size Diam 10''	<b>2.95</b>	<b>Airflow</b>	<b>120</b>	<b>180</b>	<b>240</b>	<b>300</b>	<b>360</b>	<b>420</b>	<b>480</b>
		<b>SP.</b>	0.002	0.005	0.008	0.013	0.019	0.026	0.034
		<b>NC</b>	<15	<15	<15	<15	<15	16	22
		<b>A.V (Fpm)</b>	31	42	56	68	79	88	99
<b>48 x 24</b> Neck Size Diam 10''	<b>3.45</b>	<b>Airflow</b>	<b>160</b>	<b>240</b>	<b>320</b>	<b>400</b>	<b>480</b>	<b>560</b>	<b>640</b>
		<b>SP.</b>	0.003	0.007	0.012	0.018	0.028	0.036	0.047
		<b>NC</b>	<15	<15	<15	<15	20	24	31
		<b>A.V (Fpm)</b>	31	43	56	65	78	87	97

#### Notes:

- 1- Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.
- 2- Tests Conducted in accordance with ASHREA Standard 70-2006 (sound tests are conducted at Isothermal conditions).
- 3- Ak: Free area in ft<sup>2</sup>
- 4- Airflow in Cfm
- 5- S.P: Static pressure is in Inch of Water. SP was measured at 1.5 duct diameters upstream of the inlet of the Diffuser.
- 6- Cfm/Ft<sup>2</sup>: Airflow rate through diffuser per square foot of overall face area.
- 7- NC: Noise Criteria is based on a 10db room attenuation.
- 8- A.V: Average Velocity at 6 feet below ceiling.
- 9- Test data shown is for a temperature difference DT of 5°F between the supply air temperature and the average room air temperature.
- 10- Test Room Dimensions: 18'x24'x9'



# LAMINAR FLOW DIFFUSER

## LFD/LFDW Series

### LEAKAGE DATA

The purpose of test was to define the leakage of the Filter gasket and the Laminar casing when filter is block by Dust. The perimeter seal and casing around the filter was the leakage component.

Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating". The test samples were not dampers but filters with the outlet side blocked with cardboard and taped. Air Volume was measured employing metering stations containing appropriately sized orifice plates.


Test conducted at Intertek Lab under report No. 103197431.

### AIR LEAKAGE RESULT:

MODEL LFD200-24x24, HEPA Filter H14

Pressure Drop Across Blocked Sample		Air Volume	
<u>in. Wg.</u>	<u>kPa</u>	<u>SCFM</u>	<u>L/s</u>
0.5	0.124	0.8	0.4
1.0	0.249	1.3	0.6
1.5	0.373	1.8	0.8
2.0	0.498	2.2	1.0
2.5	0.622	2.6	1.2
3.0	0.747	2.9	1.4

### GRAPHICAL TEST RESULTS

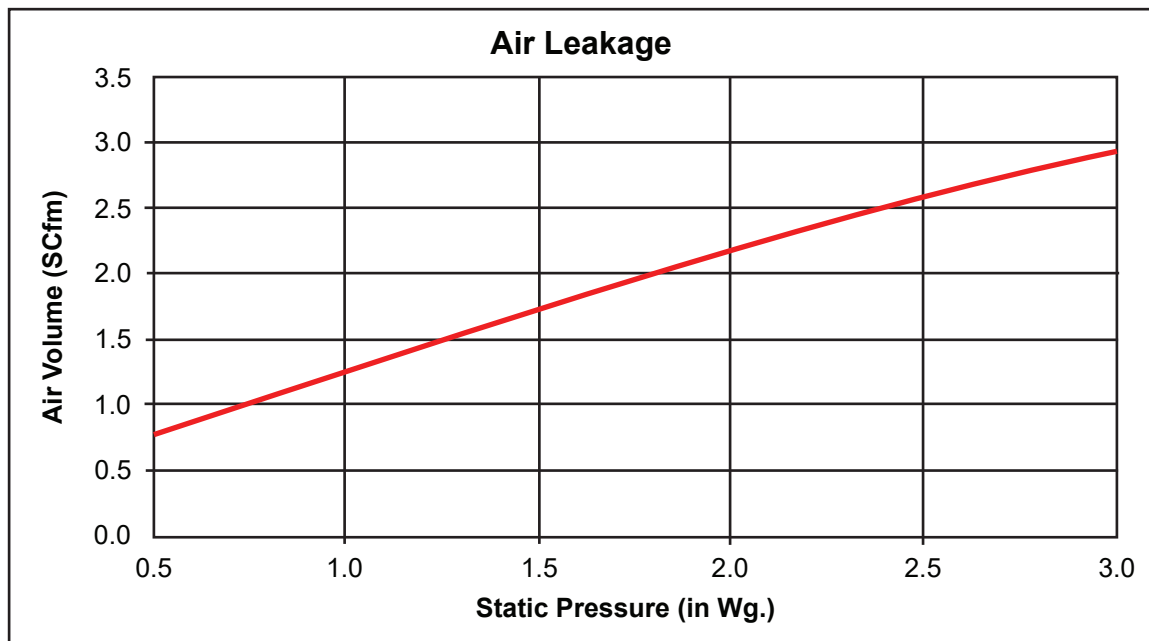

### ORDER INFORMATION


MODEL      BOX      PERFORATED      FLANGE      FILTER FIXATION      ORDER SIZE



↑  
 -LFDW200: Construction of LFD with filter support.  
 -LFDW100: Construction of Diffuser without filter support

↑  
 --: Galvanized (available for Galvanized construction only)  
 SCP: Stainless Steel 304  
 16SCP: Stainless Steel 316  
 ALP: Aluminum (available for Galvanized & Aluminum construction)

↑  
 --: Standard Clamp  
 SSH: Stainless Steel lock

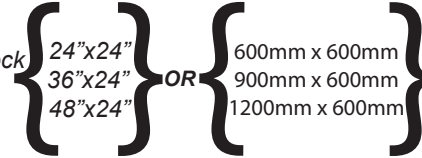

↑  
 --: 16 Ga Galvanized Steel (STD)  
 SC15: 1.5 mm Stainless Steel 304  
 16SC15: 1.5 mm Stainless Steel 316  
 AL15: 1.5 mm Aluminum

↑  
 --: No Flange (STD)  
 F : with 3 cm extruded aluminum flange for AL and GI construction  
 OR 3 cm stainless steel duct flange for SS construction

**N.B: A 0.5 cm clearance is deducted from width and height order size.**  
 For more information, please check the submittal sheet.

Tests Conducted in accordance with ASHRAE Standard 70-2006 in ETL-ETS USA  
 Leakage tests were conducted in accordance with AMCA Standard 500-D-2012 entitled, "Laboratory Methods for Testing Dampers for Rating" ETL-ETS USA.